Design Loading: Plan Service (MWPS) at lowa State University. For more specific requirements detailed in ACI 318–05. Supplemental design and ground. The design is in accordance with ultimate strength design This drawing may be used for tanks which are above or below Publication TR-9, Circular Concrete Manure Tanks (March 1998). details concerning the design refer to MidWest Plan Service This drawing is based on a design prepared by the MidWest calculations performed by TeamAg Inc. Jan 2008.

- 2. Soil backfill loads: 45 psf/ft. of depth with no surcharge Manure load: 65 psf/ft. of depth. With a factor of safety = 1.2.
- and a factor of safety = 1.6. This requires the structure backfill to be adequately drained
- To meet this requirement see backfill details on this sheet.

 3. Required soil bearing pressure greater than 2000 psi.

Construction Notes:

- 1. Reinforcing steel for footing and walls shall have a tension yield point of $f_y = 60,000 \text{ psi.}$ Refer to Sheet 2 for floor reinforcing steel grades.
- 2. For splice lengths refer to the table on Sheet 2. All bends in reinforcing steel shall have a minimum inside radius of 3 bar diameters.
- All concrete shall have a minimum 28 day compressive strength of 4,000 psi. The mix design shall be submitted to NRCS prior to Unless shown otherwise in the construction specifications,
- the following requirements shall apply: Cement shall be Type I or Type II
- Slump 3-6" inches
- Air content from 5 to 7 percent.
- Aggregate size maximum of 1 inch diameter.
- Construction joints cleaned prior to subsequent concrete placement.
- Cure concrete for a minimum of 7 days acceptable methods are: - membrane forming curing compound at rate of 1 gal/150 s.f.
- leaving the forms in place
- − soaking / continuous spray
- 4. Construction joints may be used to ease construction. The Engineer prior to placing the concrete. location of construction joints shall be approved by the
- 5. Refer to manufacturers recommendation for placing waterstop material.
- 6. Backfill shall be brought up uniformly around the tank. The maximum difference in the finished backfill elevations around the tank shall be 4 feet.
- 7. All construction methods snau niest to the regional construction Specification 313. 8. Installation of this structure shall conform to NRCS Construction Specification 313.


Safety Considerations:

- The tank shall be surrounded by a chain link or woven wire fence. (min 5' height) Posts shall be attached to the wall or the posts shall be cast into the concrete wall,
- time of installation. with an an 8" rebar welded to the base of the post. The posts must be capped at
- 3. Gates and safety stops shall be installed at pushoff locations to prevent 4. Warning signs shall be erected around the tank stating accidental entry of equipment, people and animals.


Vehicle Access

that entry may result in injury or death.

purpose of the slab is to distribute the loading along the tank wall and If heavy tank wagons, or trucks will be driven within a distance equal to the tank wall route by the tank. The concrete slab should be large enough to eliminate any height from the edge of the tank, cast a 8 inch thick concrete slab along the traffic wheel loads directly on the natural ground or backfill by the tank. The

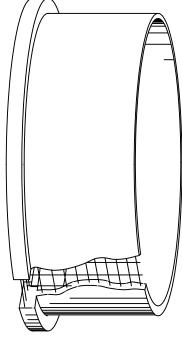

CIRCULAR CONCRETE MANURE TANK

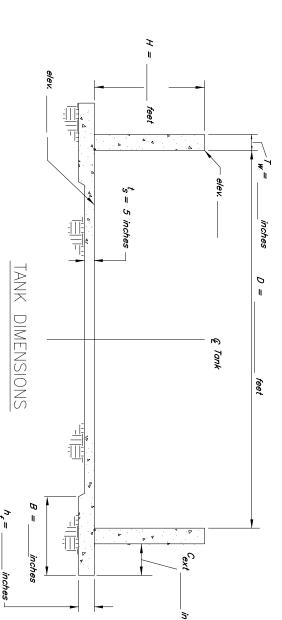

NRCS, MWPS, Pereverzoff


<u>8/08</u>

WAC, Hartz

Excavation Slope see OSHA Reg. 4" diam.-Drain Tile 6" (min.) Granular Drain Material - Top of Floor 6" (min.) 12"x 6" Band of Drain Fill 50' o.c.

WALL BACKFILL DETAIL-TYPICAL

- Provide a minimum 4 inch diameter perimeter drain tile for wall backfill
 drainage. Outlet the tile at a location downslope where flow from the outlet
 may be monitored. Provide heavy wall pipe where backfill cover is < 24".
 Provide an animal guard on all outlets.
 If a high water table is present a special drain design will be required
 under the tank floor to prevent uplift.
- 3. To provide adequate drainage, the granular drain material shall be clean
- with maximum 5 percent fines. The maximum particle size shall be 1.5 inches. Provide a 12"x6" band of granular drain material under the footing every 50' on center around the tank perimeter.
- 5. Provide Min. of 3' of backfill over top of footing for frost protection.

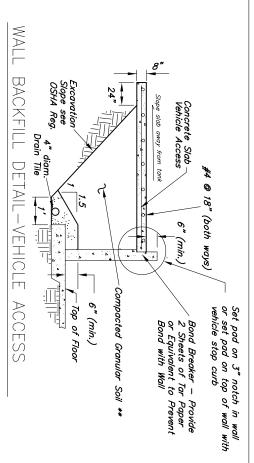

- ** Granular back fill is required under slab and shall be compacted in uniform 8 inch lifts with a minimum of 3 passes with a manually directed vibratory roller or plate vibrator. Granular backfill shall be GP, GW, SP, SW, GM, GC or equal
- Vehicle access slab is required if I trucks are driven within a distance ec from the edge of the tank. f heavy tank wagons or loaded equal to the tank wall height
- 2. Provide a 12"x6" band of granular drain material under the footing every 50' on center around the tank perimeter.

Inside Face PLAN VIEW — Waterstop (PVC) (attached to two vertical rebars) 1st Pour

TYPICAL WALL JOINT DETAIL

SPECIAL NOTES:

2nd Pour

- For tank sizes not listed use the steel spacing & wall thickness from the next larger tank size.
- design. 2. Kicker walls can NOT be used on this tank
- 3. Depth Options are 8, 12 14 feet.
- 4. Diameter range up to 200 feet.


PA-083.dwg


5. Designed for even backfill +/-2 feet only.

0	RC CONSERV	

COUNTY, PENNSYLVANIA

PENNSYLVANIA ROUND TANK NR, PA083

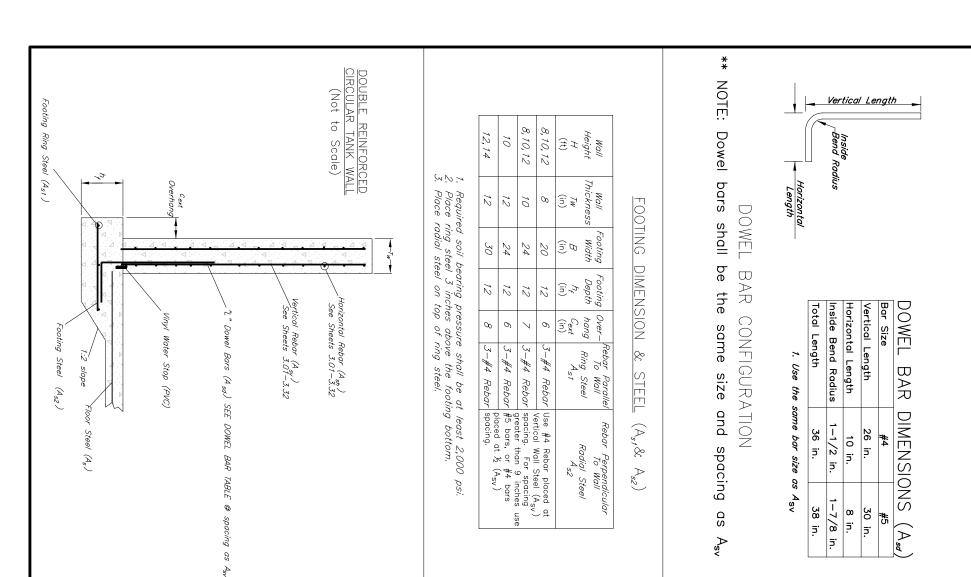

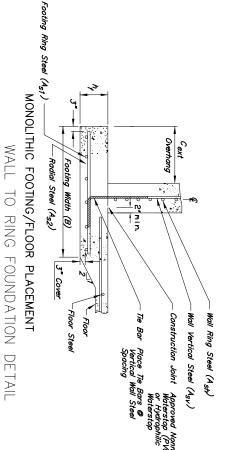

This table is for floors on coarse granular or cohesive material. For floors on sand or pervious geotextile, $A_{\rm S}$ may be reduced 50%.

* See

PA-004 and PA-063 for Joint details

>140' \le 200' .19 >90' ≤ 140' .*12*

#4 @ 12" #4 @ 18" >60' ≤ >30' ≤

90' 60,

.087 .058 .029

#3 @ 15"


6x6-W2.9xW2.9 (6 ga.) 6X6-W1.4xW1.4 (10

90.,

≤ 30 DISTANCE BETWEEN JOINTS *

FLOOR STEEL

 (A_s)

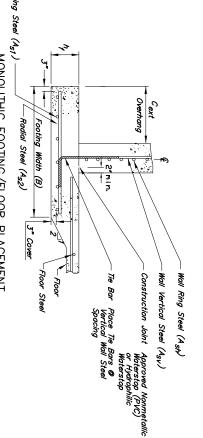

DIMENSIONS (Aso

1-1/2 in.

1-7/8 in. 38 in.

10 in.

. ∞ 30 in.

36 in.

26 in.



SPLICE LENGTHS FOR ALL BARS

Bar Size #3

Min. Splice Lengths


#5 #4

38


32 inches 25 inches 18 inches Rebar Perpendicular To Wall

Radial Steel A_{s2}

 $(A_{s}, \& A_{s2})$



- 2. Place vertical steel on the outside of the ring steel
- 1. For single mat of rebar, ring steel shall be located along the wall centerline.

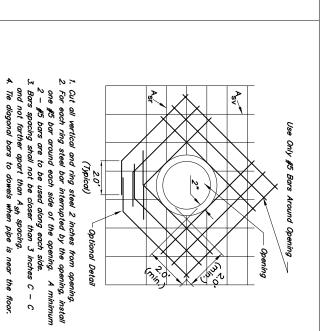

Horizontal Rebar (A_{sh.}) See Sheets 3.01–3.32

SINGLE REINFORCED CIRCULAR TANK WALL (Not to Scale)

Vertical Rebar (A_{SV})
See Sheets 3.01-3.32

,"L" Dowel Bars (A $_{\rm sd}$) SEE DOWEL BAR TABLE @ $_{\rm Spacing}$ as $A_{\rm SN}$

≠	DETAIL
†RO	위
OUGH	PIPE
\triangleright	∇
WALL	ROTRUDING

PA-083.dwg

Footing Ring Steel (A_{s1})

Footing Steel (A_{s2})

1:2 slope

Floor Steel (A_s)

C_{ext} Overhan

Vinyl Water Stop (PVC)



COUNTY, PENNSYLVANIA PENNSYLVANIA ROUND TANK NR, PA083- DETAILS Designed <u>NRCS</u>, <u>MWPS</u>, <u>Pereverzoff</u> 7/08 WAC, Hartz <u>8/08</u>

Results for the 8'x40' circular tank:

Circular tank:

Tank Diameter = 40 ftTank Wall thickness = 8 in (actual)Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
Bar#	Spacing (in)	Distance from finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	12	4' 3"
6	12	5' 3"
7	12	6' 3"
8	12	7' 3"
9	6	7' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

County, PA
ROUND TANK DETAIL
PA-083
Page 3.01

Designed PA NRCS	_12/01
Drawn <i>Hartz</i>	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 8'x60' circular tank:

Circular tank:

Tank Diameter = 60 ftTank Wall thickness = 8 in (actual)Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
Bar#	Spacing (in)	Distance from finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	12	4' 3"
6	12	5' 3"
7	12	6' 3"
8	12	7' 3"
9	6	7' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

County, PA
ROUND TANK DETAIL
PA-083
Page 3.02

Designed PA NRCS	12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Annroyad	

Results for the 8'x80' circular tank:

Circular tank:

Tank Diameter = 80 ftTank Wall thickness = 8 in (actual)Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	12	4' 3"
6	12	5' 3"
7	12	6' 3"
8	12	7' 3"
9	6	7' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

NRCS	
Natural Resources Conservation Services United States Department of Agriculture	

County, PA
ROUND TANK DETAIL
PA-083
Page 3.03

Designed PA NRCS	_12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Annroyed	

Results for the 8'x100' circular tank:

Circular tank:

Tank Diameter = 100 ft Tank Wall thickness = 8 in (actual) Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	12	4' 3"
6	12	5' 3"
7	10	6' 1"
8	10	6' 11"
9	10	7' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

O NRCS	
Natural Resources Conservation Services United States Department of Agriculture	

County, PA
ROUND TANK DETAIL
PA-083
Page 3.04

Designed PA NRCS	12/01
Drawn <i>Hartz</i>	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 8'x120' circular tank:

Circular tank:

Tank Diameter = 120 ft Tank Wall thickness = 8 in (actual) Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	10	3' 1"
5	10	3' 11"
6	10	4' 9"
7	9	5' 6"
8	9	6' 3"
9	9	7' 0"
10	9	7' 9"

Vertical Steel = #4 @ 12" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. 26" vertical leg, 6" horizontal leg

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

County, PA
ROUND TANK DETAIL
PA-083
Page 3.05

Designed	PA NRCS	_12/01
Drawn	Hartz	11/14/08
Revisions	Pereverzoff	1/9/08
Checked _		
Approved		

Results for the 8'x140' circular tank:

Circular tank:

Tank Diameter = 140 ft Tank Wall thickness = 10 in (actual) Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	10	3' 1"
5	10	3' 11"
6	8	4' 7"
7	8	5' 3"
8	6	5' 9"
9	6	6' 3"
10	6	6' 9"
11	6	7' 3"
12	6	7' 9"

Vertical Steel = #4 @ 12" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. 26" vertical leg, 8" horizontal leg

O NRCS	
Natural Resources Conservation Services United States Department of Agriculture	

Designed PA NRCS	12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 8'x160' circular tank:

Circular tank:

Tank Diameter = 160 ftTank Wall thickness = 10 in (actual)Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar#	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	10	2' 1"
4	10	2' 11"
5	8	3' 7"
6	8	4' 3"
7	6	4' 9"
8	6	5' 3"
9	6	5' 9"
10	6	6' 3"
11	6	6' 9"
12	6	7' 3"
13	6	7' 9"

Vertical Steel = #4 @ 12" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. 26" vertical leg, 8" horizontal leg

O NRCS		
Natural Resources Conservation Services United States Department of Agriculture		

County, PA			
ROUND TANK DETAIL			
PA-083			
Page 3 07			

Designed PA NRCS	_12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 8'x180' circular tank:

Circular tank:

Tank Diameter = 180 ftTank Wall thickness = 10 in (actual)Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}		
	Distance from	
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	10	4' 1"
6	10	4' 11"
7	10	5' 9"
8	8	6' 5"
9	8	7' 1"
10	8	7' 9"

Vertical Steel = #4 @ 12" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. 26" vertical leg, 8" horizontal leg

O NRCS		
Natural Resources Conservation Services United States Department of Agriculture		

County, PA
ROUND TANK DETAIL
PA-083
Page 3.08

Designed PA NRCS	_12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 8'x200' circular tank:

Circular tank:

Tank Diameter = 200 ft Tank Wall thickness = 12 in (actual) Tank Height = 8 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}			
Steel sho	Steel shown in table must be placed in each		
face of the wall			
	Distance from		
Bar #	Spacing (in)	finished floor (ft - in)	
1	3 0' 3"		
2	2 12 1'3"		
3	12	2' 3"	
4	12	3' 3"	
5	12	4' 3"	
6	12	5' 3"	
7	8	5' 11"	
8	8	6' 7"	
9	8	7' 3"	
10	10 6 7' 9"		

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 6" horizontal leg

,0,	VIRCS
	VIIV
	rces Conservation Services
United States D	Department of Agriculture

Designed PA NRCS	_12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x40' circular tank:

Circular tank:

Tank Diameter = 40 ftTank Wall thickness = 8 in (actual)Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	12	3' 3"
5	12	4' 3"
6	12	5' 3"
7	12	6' 3"
8	12	7' 3"
9	12	8' 3"
10	12	9' 3"
11	6	9' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

0	V	RCS
Natural Resources Conservation Services United States Department of Agriculture		

County, PA			
ROUND TANK DETAIL			
PA-083			
Page 3.10			

Designed PA NRCS	_12/01
Drawn Hartz	11/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x60' circular tank:

Circular tank:

Tank Diameter = 60 ftTank Wall thickness = 8 in (actual)Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar#	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	10	2' 1"
4	10	2' 11"
5	10	3' 9"
6	10	4' 7"
7	10	5' 5"
8	10	6' 3"
9	12	7' 3"
10	12	8' 3"
11	12	9' 3"
12	6	9' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

County, PA			
ROUND TANK DETAIL			
PA-083			
Page 3.11			

Designed PA NRCS	_12/01
Drawn Hartz	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x80' circular tank:

Circular tank:

Tank Diameter = 80 ftTank Wall thickness = 8 in (actual)Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar#	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	10	1' 1"
3	10	1' 11"
4	10	2' 9"
5	9	3' 6"
6	9	4' 3"
7	9	5' 0"
8	9	5' 9"
9	10	6' 7"
10	10	7' 5"
11	10	8' 3"
12	10	9' 1"
13	8	9' 9"

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

Dowels "L" bars shall be #4 @ 12" O.C. with a horizontal leg of 6" and a vertical leg of 26"

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed	PA NRCS	12/01
	Hartz	8/14/08
Revisions	Pereverzoff	1/9/08
Checked _		
Approved		

Results for the 10'x100' circular tank:

Circular tank:

Tank Diameter = 100 ftTank Wall thickness = 10 in (actual)Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}			
		Distance from	
Bar#	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	10	1' 1"	
3	10	1' 11"	
4	10	2' 9"	
5	8	3' 5"	
6	8	4' 1"	
7	8	4' 9"	
8	8	5' 5"	
9	8	6' 1"	
10	8	6' 9"	
11	8	7' 5"	
12	8	8' 1"	
13	10	8' 11"	
13	10	9' 9"	

Vertical Steel shall be #4 @ 10" O.C. = A_{sv}

O NRCS	
Natural Resources Conservation Service United States Department of Agriculture	

County, PA
ROUND TANK DETAIL
PA-083
Page 3.13

Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x120' circular tank:

Circular tank:

Tank Diameter = 120 ft Tank Wall thickness = 10 in (actual) Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}					
		Distance from			
Bar#	Spacing (in)	finished floor (ft - in)			
1	3	0' 3"			
2	12	1' 3"			
3	10	2' 1"			
4	8	2' 9"			
5	8	3' 5"			
6	8	4' 1"			
7	8	4' 9"			
8	8	5' 5"			
9	8	6' 1"			
10	8	6' 9"			
11	6	7' 3"			
12	6	7' 9"			
13	6	8' 3"			
14	6	8' 9"			
15	6	9' 3"			
16	6	9' 9"			

Vertical Steel = #4 @ 10" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 10" O.C. 26" vertical leg, 8" horizontal leg

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x140' circular tank:

Circular tank:

Tank Diameter = 140 ft Tank Wall thickness = 10 in (actual) Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}				
		Distance from		
Bar#	Spacing (in)	finished floor (ft - in)		
1	3 0' 3"			
2	12	1' 3"		
3	12	2' 3"		
4	12	3' 3"		
5	12	4' 3"		
6	10	5' 1"		
7	7 10 5' 11"			
8	8 10 6' 9"			
9	10	7' 7"		
10	10	8' 5"		
11	9	9' 2"		
12	12 7 9' 9"			

Vertical Steel = #4 @ 10" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 10" O.C. 26" vertical leg, 8" horizontal leg

.0.		20	7	
Natural Resource	N I es Co	nserv	ation Se	rvices
United States De				

County, PA
ROUND TANK DETAIL
PA-083
Page 3.15

Designed PA NRCS	_12/01
Drawn Hartz	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x160' circular tank:

Circular tank:

Tank Diameter = 160 ft Tank Wall thickness = 10 in (actual) Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}					
		Distance from			
Bar#	Spacing (in)	finished floor (ft - in)			
1	3 0'3"				
2	12	1' 3"			
3	12	2' 3"			
4	12	3' 3"			
5	10	4' 1"			
6	6 10 4' 11'				
7	10	5' 9"			
8	8 8 6' 5"				
9	9 8 7'1"				
10	0 8 7'9"				
11	8	8' 5"			
12	8	9' 1"			
13	13 8 9' 9"				

Vertical Steel = #4 @ 10" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 10" O.C. 26" vertical leg, 8" horizontal leg

10	R	(5	
Natural Resour United States De	 			

County, PA		
ROUND TANK DETAIL		
PA-083		
Page 3.16		

Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 10'x180' circular tank:

Circular tank:

Tank Diameter = 180 ft Tank Wall thickness = 10 in (actual) Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}		
		Distance from
Bar#	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	12	2' 3"
4	10	3' 1"
5	10	3' 11"
6	8	4' 7"
7	8	5' 3"
8	8	5' 11"
9	8	6' 7"
10	8	7' 3"
11	6	7' 9"
12	6	8' 3"
13	6	8' 9"
14 6		9' 3"
15	6	9' 9"

Vertical Steel = #4 @ 9" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 9" O.C. 26" vertical leg, 8" horizontal leg

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed PA NR	CS _12/01
Drawn Hartz	8/14/08
Revisions Perever	rzoff 1/9/08
Checked	
Approved	

Results for the 10'x200' circular tank:

Circular tank:

Tank Diameter = 200 ft Tank Wall thickness = 12 in (actual) Tank Height = 10 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh} Steel shown in table must be placed in each face of the wall			
	Distance from		
Bar #	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	12	3' 3"	
5	10	4' 1"	
6	10	4' 11"	
7	10	5' 9"	
8 10		6' 7"	
9	8	7' 3"	
10 8		7' 11"	
11	8	8' 7"	
12	8	9' 3"	
13	6	9' 9"	

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 8" horizontal leg

^	NIDCC
	INKC2
	urces Conservation Services Department of Agriculture

County, PA		
ROUND TANK DETAIL		
PA-083		
Page 3.18		

Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 12'x40' circular tank:

Circular tank:

Tank Diameter = 40 ft Tank Wall thickness = 8 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}			
		Distance from	
Bar #	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	10	3' 1"	
5	10	3' 11"	
6	10	4' 9"	
7	10	5' 7"	
8	10	6' 5"	
9	10	7' 3"	
10	12	8' 3"	
11	12	9' 3"	
12	12	10' 3"	
13	12	11' 3"	
14	6	11' 9"	

Vertical Steel shall be #4 @ 12" O.C. = A_{sv}

Dowels "L" bars shall be #4 @ 12" O.C. with a horizontal leg of 6" and a vertical leg of 26"

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 12'x60' circular tank:

Circular tank:

Tank Diameter = 60 ft Tank Wall thickness = 10 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
		Distance from
Bar#	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	10	2' 1"
4	10	2' 11"
5	9	3' 8"
6	9	4' 5"
7	9	5' 2"
8	9	5' 11"
9	9	6' 8"
10	10	7' 6"
11	10	8' 4"
12	12	9' 4"
13	12	10' 4"
14	12	11' 4"
15	5	11' 9"

Vertical Steel = #4 @ 10" O.C. = A_{sv}

0	V	RCS
		Conservation Services tment of Agriculture

County, PA
ROUND TANK DETAIL
PA-083
Page 3.20

Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 12'x80' circular tank:

Circular tank:

Tank Diameter = 80 ftTank Wall thickness = 10 in (actual)Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
Bar#	Spacing (in)	Distance from finished floor (ft - in)
1	3	0' 3"
2	10	1' 1"
3	10	1' 11"
4	8	2' 7"
5	8	3' 3"
6	8	3' 11"
7	8	4' 7"
8	6	5' 1"
9	6	5' 7"
10	6	6' 1"
11	6	6' 7"
12	6	7' 1"
13	8	7' 9"
14	8	8' 5"
15	10	9' 3"
16	10	10' 1"
17	10	10' 11"
18	10	11' 9"

Vertical Steel shall be #4 @ 9" O.C. = A_{sv}

Dowels "L" bars shall be #4 @ 9" O.C. with a horizontal leg of 8" and a vertical leg of 26"



Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 12'x100' circular tank:

Circular tank:

Tank Diameter = 100 ftTank Wall thickness = 10 in (actual)Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizoi	Horizontal Steel = #5 rebar = A _{sh}		
		Distance from	
Bar#	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	10	3' 1"	
5	10	3' 11"	
6	10	4' 9"	
7	10	5' 7"	
8	10	6' 5"	
9	10	7' 3"	
10	10	8' 1"	
11	10	8' 11"	
12	10	9' 9"	
13	12	10' 9"	
14	12	11' 9"	

Vertical Steel shall be #4 @ 8" O.C. = A_{sv}

Dowels "L" bars shall be #4 @ 8" O.C. with a horizontal leg of 8" and a vertical leg of 26"

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed PA NRCS	_12/01
Drawn Hartz	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 12'x120' circular tank:

Circular tank:

Tank Diameter = 120 ft Tank Wall thickness = 10 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3	10	2' 1"
4	10	2' 11"
5	10	3' 9"
6	8	4' 5"
7	8	5' 1"
8	8	5' 9"
9	8	6' 5"
10	8	7' 1"
11	8	7' 9"
12	8	8' 5"
13	10	9' 3"
14	10	10' 1"
15	10	10' 11"
16	10	11' 9"

Vertical Steel = #5 @ 10" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #5 @ 10" O.C. 30" vertical leg, 8" horizontal leg

O NRCS
Natural Resources Conservation Services United States Department of Agriculture

Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 12'x140' circular tank:

Circular tank:

Tank Diameter = 140 ft Tank Wall thickness = 10 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}			
_		Distance from	
Bar#	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	10	3' 1"	
5	8	3' 9"	
6	8	4' 5"	
7	8	5' 1"	
8	8	5' 9"	
9	8	6' 5"	
10	8	7' 1"	
11	8	7' 9"	
12	8	8' 5"	
13	8	9' 1"	
14	8	9' 9"	
15	8	10' 5"	
16	8	11' 1"	
17	8	11' 9"	

Vertical Steel = #5 @ 10" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #5 @ 10" O.C. 30" vertical leg, 8" horizontal leg

O NRCS)
Natural Resources Conservation United States Department of Agri	

Designed PA NRCS	_12/01
Drawn Hartz	8/14/08
Revisions Pereverzof	f 1/9/08
Checked	
l	
Approved	

Results for the 12'x160' circular tank:

Circular tank:

Tank Diameter = 160 ft Tank Wall thickness = 12 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}			
Steel shown in table must be placed in each			
face of th	face of the wall		
		Distance from	
Bar #	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	10	3' 1"	
5	10	3' 11"	
6	10	4' 9"	
7	10	5' 7"	
8	10	6' 5"	
9	10	7' 3"	
10	9	8' 0"	
11	9	8' 9"	
12	9	9' 6"	
13	9	10' 3"	
14	9	11' 0"	
15	9 11' 9"		

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg

^	NIDCC
0	INKCS
	ources Conservation Services Department of Agriculture

Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 12'x180' circular tank:

Circular tank:

Tank Diameter = 180 ft Tank Wall thickness = 12 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}				
Steel shown in table must be placed in each				
face of th	face of the wall			
		Distance from		
Bar #	Spacing (in)	finished floor (ft - in)		
1	3	0' 3"		
2	10	1' 1"		
3	10	1' 11"		
4	10	2' 9"		
5	10	3' 7"		
6	10	4' 5"		
7	8	5' 1"		
8	8	5' 9"		
9	8	6' 5"		
10	8	7' 1"		
11	8	7' 9"		
12	8	8' 5"		
13	8	9' 1"		
14	8	9' 9"		
15	8	10' 5"		
16	8	11' 1"		
17	8	11' 9"		

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg

A NIDCC	
O INK()	
Natural Resources Conservation Service United States Department of Agriculture	

Designed	PA NRCS	_12/01
Drawn	Hartz,	8/14/08
Revisions	Pereverzoff	1/9/08
Checked		
Approved		

Results for the 12'x200' circular tank:

Circular tank:

Tank Diameter = 200 ft Tank Wall thickness = 12 in (actual) Tank Height = 12 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh} Steel shown in table must be placed in each face of the wall			
	Distance from		
Bar #	Spacing (in)	finished floor (ft - in)	
1	3	0' 3"	
2	14	1' 5"	
3	12	2' 5"	
4	12	3' 5"	
5	12	4' 5"	
6	12	5' 5"	
7	12	6' 5"	
8	12	7' 5"	
9	12	8' 5"	
10	10	9' 3"	
11	10	10' 1"	
12	10	10' 11"	
13	10	11' 9"	

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg

0,	V	R	CS
			rvation Services t of Agriculture

County, PA
ROUND TANK DETAIL
PA-083
Page 3.27

Designed	PA NRCS	_12/01
Drawn	Hartz,	8/14/08
Revisions	Pereverzoff	1/9/08
Checked		
Approved		

Results for the 14'x120' circular tank:

Circular tank:

Tank Diameter = 120 ft Tank Wall thickness = 10 in (actual) Tank Height = 14 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh}		
	Distance from	
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	10	1' 1"
3 4	10	1' 11"
4	8	2' 7"
5	8	3' 3"
6	6	3' 9"
7	6	4' 3"
8	6	4' 9"
9	6	5' 3"
10	6	5' 9"
11	6	6' 3"
12	6	6' 9"
13	6	7' 3"
14	6	7' 9"
15	6	8' 3"
16	6	8' 9"
17	8	9' 5"
18	8	10' 1"
19	8	10' 9"
20	10	11' 7"
21	10	12' 5"
22	10	13' 3"
23	6	13' 9"

Vertical Steel = #5 @ 8" O.C. = A_{sv}

Dowels "L" bars from tank to footing shall be #5 @ 8" O.C. 30" vertical leg, 8" horizontal leg



Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 14'x140' circular tank:

Circular tank:

Tank Diameter = 140 ft Tank Wall thickness = 12 in (actual) Tank Height = 14 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}			
Steel shown in table must be placed in each			
	face of the wall		
Bar #	Spacing (in)	Distance from	
		finished floor (ft - in)	
1	3	0' 3"	
2	12	1' 3"	
3	12	2' 3"	
4	12	3' 3"	
5	10	4' 1"	
6	10	4' 11"	
7	8	5' 7"	
8	8	6' 3"	
9	8	6' 11"	
10	8	7' 7"	
11	8	8' 3"	
12	8	8' 11"	
13	8	9' 7"	
14	8	10' 3"	
15	10	11' 1"	
16	10	11' 11"	
17	10	12' 9"	
18	12	13' 9"	

Vertical Steel = #4 @ 12" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 12" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg



Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 14'x160' circular tank:

Circular tank:

Tank Diameter = 160 ftTank Wall thickness = 12 in (actual)Tank Height = 14 ft f_y = 60,000 psi f'_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
Steel shown in table must be placed in each		
face of th	ne wall	
Bar #	Spacing (in)	Distance from
		finished floor (ft - in)
1	3	0' 3"
2	10	1' 1"
3 4	10	1' 11"
	10	2' 9"
5	9	3' 6"
6	9	4' 3"
7	9	5' 0"
8	9	5' 9"
9	8	6' 5"
10	8	7' 1"
11	8	7' 9"
12	8	8' 5"
13	8	9' 1"
14	8	9' 9"
15	8	10' 5"
16	8	11' 1"
17	8	11' 9"
18	8	12' 5"
19	8	13' 1"
20	8	13' 9"

Vertical Steel = #4 @ 10" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 10" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg



Designed PA NRCS	_12/01
Drawn Hartz	8/14/08
Revisions Pereverzoff	1/9/08
Checked	
Approved	

Results for the 14'x180' circular tank:

Circular tank:

Tank Diameter = 180 ftTank Wall thickness = 12 in (actual)Tank Height = 14 ft f_y = 60,000 psi f'_c = 4,000 psi

Horizontal Steel = #4 rebar = A _{sh}		
Steel shown in table must be placed in each		
face of the wall		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	12	1' 3"
3 4	12	2' 3"
	10	3' 1"
5 6	10	3' 11"
6	8	4' 7"
7	8	5' 3"
8	8	5' 11"
9	8	6' 7"
10	8	7' 3"
11	6	7' 9"
12	6	8' 3"
13	6	8' 9"
14	6	9' 3"
15	6	9' 9"
16	6	10' 3"
17	6	10' 9"
18	6	11' 3"
19	6	11' 9"
20	6	12' 3"
21	6	12' 9"
22	6	13' 3"
23	6	13' 9"

Vertical Steel = #4 @ 9" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 9" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg

A NIDCC	
O INK()	
Natural Resources Conservation Service United States Department of Agriculture	

Designed	PA NRCS	_12/01
Drawn	<u>Hartz</u>	8/14/08
Revisions	<u>Pereverzoff</u>	1/9/08
Checked		
Approved		

Results for the 14'x200' circular tank:

Circular tank:

Tank Diameter = 200 ft Tank Wall thickness = 12 in (actual) Tank Height = 14 ft f_y = 60,000 psi f_c = 4,000 psi

Horizontal Steel = #5 rebar = A _{sh} Steel shown in table must be placed in each face of the wall		
		Distance from
Bar #	Spacing (in)	finished floor (ft - in)
1	3	0' 3"
2	18	1' 9"
3	18	3' 3"
4	12	4' 3"
5	12	5' 3"
6	12	6' 3"
7	10	7' 1"
8	10	7' 11"
9	10	8' 9"
10	10	9' 7"
11	10	10' 5"
12	10	11' 3"
13	10	12' 1"
14	10	12' 11"
15	10	13' 9"

Vertical Steel = #4 @ 9" O.C. in each face. = A_{sv}

Dowels "L" bars from tank to footing shall be #4 @ 9" O.C. at the interior mat of steel. 26" vertical leg, 10" horizontal leg

^	NIDCC
0	INKCS
	ources Conservation Services Department of Agriculture

Designed PA NRCS	_12/01
Drawn <u>Hartz</u>	8/14/08
Revisions Pereverzoff	1/9/08
-	
Checked	
Approved	